



PROJECT CONCEPT NOTE

CARBON OFFSET UNIT (CoU) PROJECT



Title: 11 MW Biomass based power supply to grid in Uttar Pradesh

Version 1.0

Date 30/01/2023

First CoU Issuance Period: 10 years, 0 months

Date: 01/01/2013 to 31/12/2022



Project Concept Note (PCN)
CARBON OFFSET UNIT (CoU) PROJECT

BASIC INFORMATION

Title of the project activity	11 MW Biomass based power supply to grid in Uttar Pradesh
Scale of the project activity	Large Scale
Completion date of the PCN	30/01/2023
Project participants	First Climate (India) Private Limited (Aggregator) Balrampur Chini Mills Ltd. (Developer)
Host Party	India
Applied methodologies and standardized baselines	CDM UNFCCC Methodology ACM0006: Electricity and heat generation from biomass (version 16.0)
Sectoral scopes	01 Energy industries (Renewable/Non Renewable Sources)
Estimated amount of total GHG emission reductions	31,126 CoUs/year (31,126 tCO _{2e} /year)

SECTION A. Description of project activity

A.1. Purpose and general description of Carbon offset Unit (CoU) project activity >>

The project activity involves 11 MW bagasse fuelled green power supply to grid. The project is developed by Balrampur Chini Mills Limited. Location of the project activity is in Village Mijhaura, Tehsil Bhati, District Ambedkar Nagar, State Uttar Pradesh, and Country India.

The details of the registered project are as follows:

Purpose of the project activity:

Akbarpur Chini Mills is a unit of Balrampur Chini Mills Ltd., located in Ambedkar Nagar district of Uttar Pradesh. Plant has installed two biomass fired boilers of 80 TPH capacity each, totalling to 160 TPH. Both the boilers are connected with a common steam header and are together connected to three turbines of a total 18 MW capacity (3 x 6 MW), where there is currently one extraction cum condensate turbine and two back pressure turbines. The cogeneration facility generates steam for both process needs and meeting the electricity requirements of the plant. After meeting the captive demand of electricity, surplus electricity is exported to the grid. The state discom, Uttar Pradesh Power Corporation Limited (UPPCL) has signed a PPA for 11 MW with the plant to supply surplus electricity to grid. Hence, the purpose of the project activity is to provide renewable energy powered electricity to the grid and increase the access of green electricity from the grid for consumers, plus increasing the percentage of renewable energy mix in the grid.

In absence of the project activity, equivalent amount of electricity which is supplied by this project activity would have been obtained by the grid from fossil fuel based power plant(s) connected to this grid, as coal is the common fuel for thermal energy generation in India. The plant was commissioned on 23/12/2004 while the actual connectivity to grid started from 27/02/2006 vide a PPA with the Uttar Pradesh state discom. As per UCR guideline, start date of the crediting period would be considered from 01/01/2013.

Thus the project activity would replace the coal-fired electricity with green electricity, which would have otherwise been supplied by the fossil fuel based thermal power plant connected to the grid. By implementing this project, the project activity is expected to reduce the anthropogenic Greenhouse gas (GHG) emissions by 31,126 t-CO₂e/year.



Figure 1: A picture of Akbarpur Chini Mill


A.2 Do no harm or Impact test of the project activity>>

There are social, environmental, economic and technological benefits which contribute to sustainable development.

- **Social benefits:**
 - Employment for skilled, semi-skilled and unskilled labour in the project location for operational and maintenance of the equipments.
 - The plant will inspire renewable energy adoption in the nearby areas and educate people on the benefits of adopting more sustainable lifestyles.
- **Environmental benefits:**
 - Replacing fossil fuels such as coal with renewable resources like biomass, will reduce the greenhouse gas emissions globally in the atmosphere.
 - Project activity uses bagasse as a fuel for boilers which is an industrial biomass residue that is being repurposed. This promotes efficient waste management and handling practices.
 - Using renewable energy resources, the demand for consumption of fossil fuel will also decrease; in order to shift to clean and green energy. Renewable energy so supplied to state grid, which is further connected to the national grid increases green electricity availability for consumers.
- **Economic benefits:**
 - The project activity will reduce the Production facility's dependence on fossil fuel. This will reduce the overall dependence of the whole region on fossil fuel imports, benefitting the country's foreign exchange reserves.
 - Results in increased business opportunities for local contractors and suppliers during the various phases.
- **Technically well-being:**
 - The technology being adopted is a good example of application of established technologies developed within the country for power generation, thus positively contributing to the technological well-being.

The project activity, beside "Climate action" (i.e., SDG 13), addresses multiple other UN SDGs too. The list of the SDGs addressed through the Project is mentioned below:

SDG	The Project contributes to	Description of contribution
 SDG 7: Affordable and Clean Energy	Target: 7.1 Indicator: 7.1.2 Target: 7.2 Indicator: 7.2.1 Target: 7.a Indicator: 7.a.1 Target: 7.b	Biomass fired system is a carbon neutral system and by requesting submission of this project under UCR, the project owner is evidently seeking international cooperation to facilitate investment into clean energy infrastructure. By using bagasse based fired system, the demand of fossil

	Indicator: 7.b.1	fuels is reduced. Also bagasse is considered as renewable source.
 SDG 8: Decent work and Economic Growth	Target: 8.4 Indicator: 8.4.1	By using renewable energy sources for economic productivity to achieve same outcomes at the process level- the project owner aims to decouple environmental degradation, global warming and climate crisis from economic productivity.
 SDG 9: Industry, Innovation and Infrastructure	Target: 9.4 Indicator: 9.4.1	The project directly contributes to abatement of carbon dioxide emissions.
 SDG 12: Responsible Consumption and Production	Target: 12.2 Indicator: 12.2.1 Target: 12.5 Indicator: 12.5.1 Target: 12.a Indicator: 12.a.1	As bagasse cannot be processed or used further by the sugar industry it is considered as an industrial waste product. Hence the waste is been utilized which would otherwise have been dumped.
 SDG 13: Climate Action	Target: 13.2 Indicator: 13.2.2	Biomass based systems reduce the GHG emissions of the planet at large.

A.3. Location of project activity >>

Country: India

District: Ambedkar Nagar

Village: Mijhaura

Tehsil: Bhati

State: Uttar Pradesh

Code: 224152

The project site is well connected by district and village roads to the nearest town. The geographic co-ordinates of the project location are:

Latitude: 26.4773 N

Longitude: 82.4127 E



A.4. Technologies/measures >>

Process flow chart:

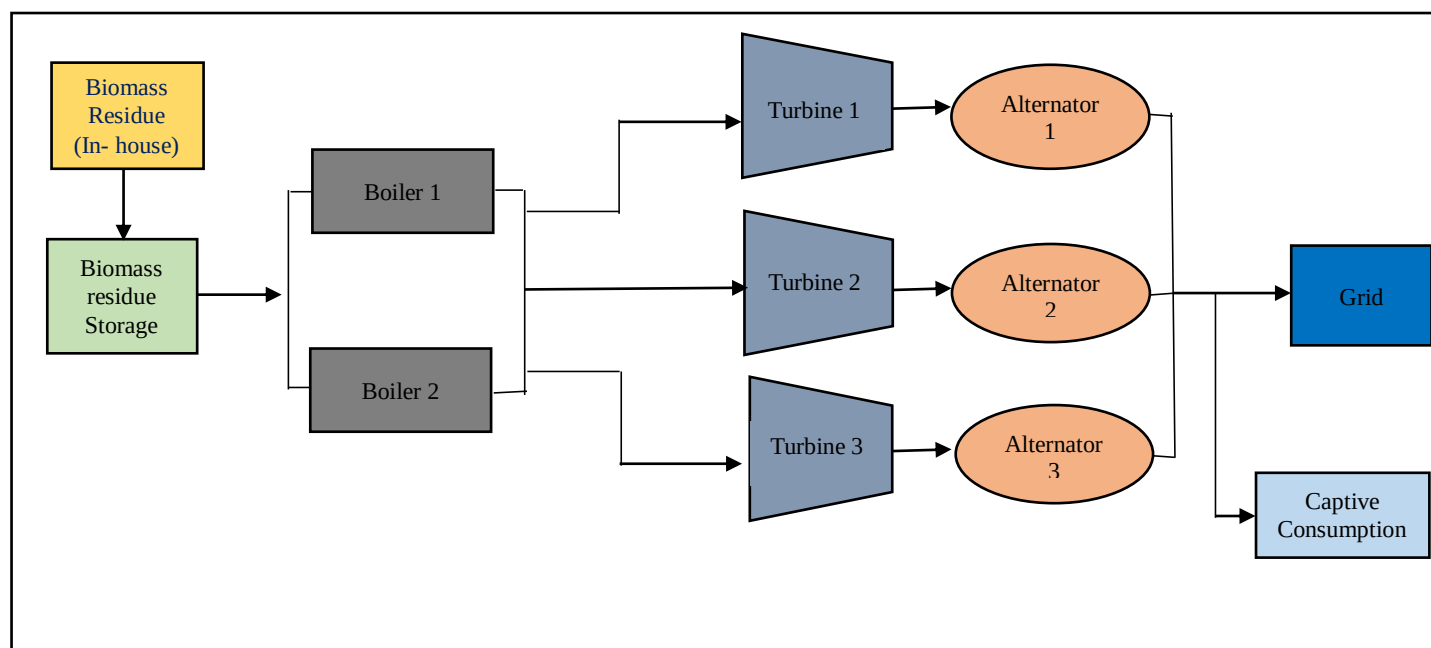


Figure 2: Schematic representation of the process flow chart

The project activity involves generation of both thermal and electrical energy from the combustion of renewable biomass i.e. bagasse, to generate process steam and electricity for captive consumption and grid supply. The technology employed is a biomass-based cogeneration system, generating steam and electricity. Thus, the technology to be used in this project is environmentally safe & sound. Emission reductions will be claimed for electricity exported to the grid only.

Details of the technical concept is as follows:

The sugar mill demands both electrical and thermal energy to run the process. To meet the demand, plant has installed a biomass fired co-generation system at their facility.

Technical details of boiler and turbine are tabulated below:

Boiler: Dumping Grate (2 No.s, each of 80 TPH capacity)

Parameter	Unit	Value
Boiler rated capacity	TPH	80 (total 160)
Nameplate Steam Pressure	kg/cm ²	54
Nameplate Steam Temperature	Deg. C	440
Fuel Type	-	Bagasse

Turbine: Back pressure (2 No.s)

Parameter	Unit	Value
Inlet steam pressure	kg/cm ²	45
Inlet steam temperature	Deg. C	440
Extraction pressure	kg/cm ²	2
Maximum output	KW	6000



Figure 3: Turbine extraction cum bleed condensing

Turbine- Extraction Cum Bleed Condensing (1 No.):

Parameter	Unit	Value
Inlet stem Pressure	ATA	44.03
Inlet steam temperature	° C	425
Inlet steam flow	TPH	43.986
Bleed pressure	ATA	5.04
Bleed flow	TPH	7.62
Extraction pressure	ATA	2.25
Extraction flow	TPH	29.30
Exhaust Steam pressure	ATA	0.10
Exhaust Steam flow	TPH	7.05
Power output	KW	6000



Figure 4: An image of a turbo-generator within the plant

A.5. Parties and project participants >>

Party (Host)	Participants
India	First Climate (India) Private Limited (AGGREGATOR) Contact person: Partha P Chaudhuri Mobile: +91 9831012824 Address: 903, ERGO Tower, Plot No. A1-4, Block EP & GP, Sector V, Salt Lake, Kolkata 700 091 Balrampur Chini Mills Limited (DEVELOPER) Phone: (033) 2287-4749 Address: “FMC FORTUNA” 2nd floor, 234/3A, A.J.C Bose road Kolkata 700 020

A.6. Baseline Emissions>>

The baseline scenario identified at the PCN stage of the project activity is:

In absence of the project activity, the energy supplied by the plant to grid would have been supplied by fossil fuel dominated power plants connected to the grid. Due to the combustion of fossil fuel such as coal, emissions of carbon dioxide would have occurred. Since the project activity is using bagasse as fuel, which is a renewable and carbon neutral fuel, it is reducing greenhouse gas emissions by avoiding combustion of coal / fossil fuels.

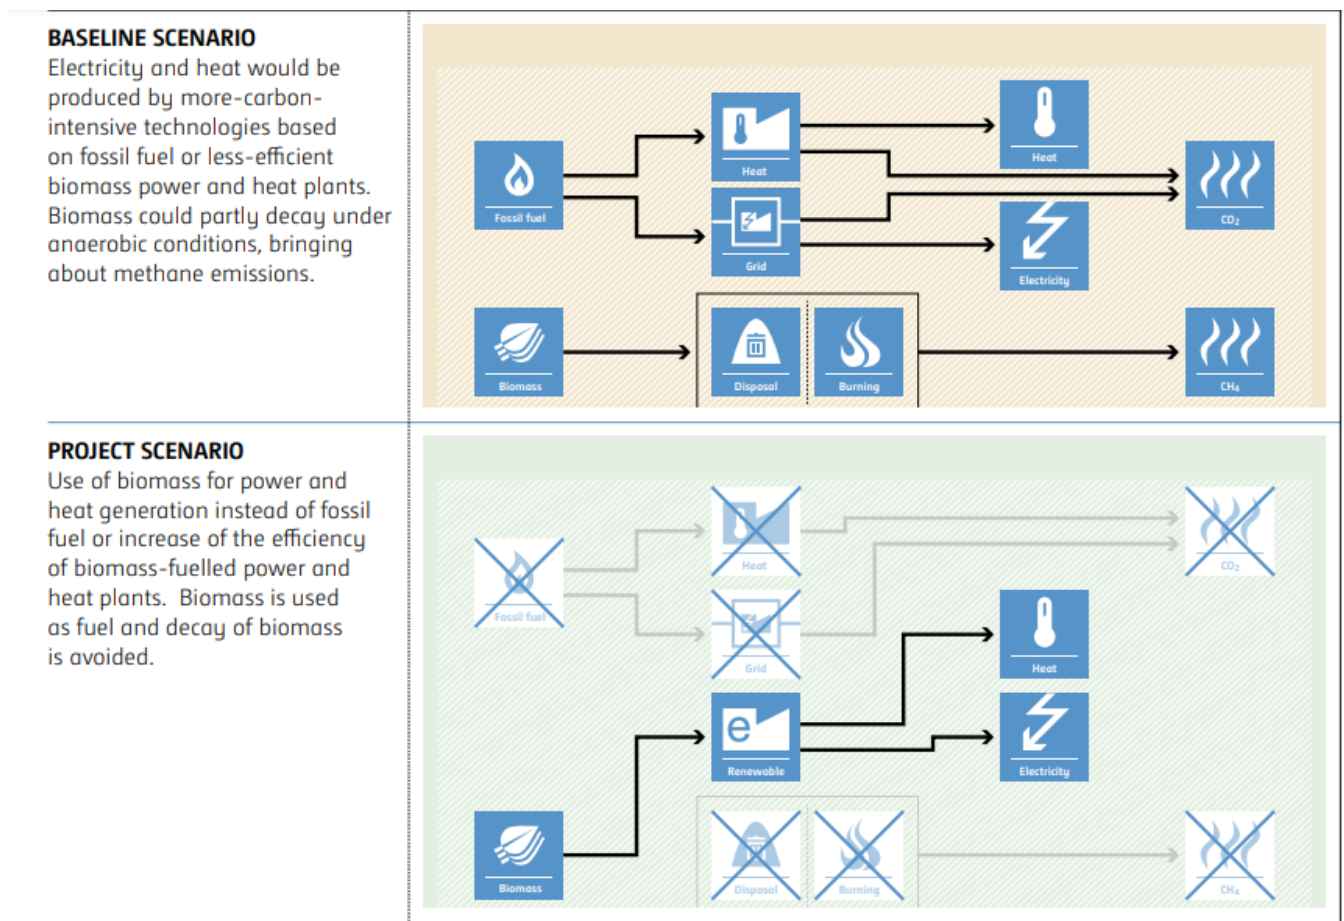


Diagram showing the comparison between baseline scenario and the project activity

A.7. Debundling>>

This project is a greenfield project and not a debundled component of a larger project activity. The project can be tracked using its unique geo-coordinates.

SECTION B. Application of methodologies and standardized baselines

B.1. References to methodologies and standardized baselines >>

SECTORAL SCOPE – 01 Energy industries (Renewable/Non-renewable sources)

TYPE - I - Renewable Energy Projects

CATEGORY- ACM0006 Electricity and heat generation from biomass (Version 16.0)

B.2. Applicability of methodologies and standardized baselines >>

Applicability Criteria	Project Condition
<i>“The methodology is applicable under the following conditions:</i> <i>(a) Biomass used by the project plant is limited to biomass residues, biogas, RDF and/or biomass from dedicated plantations;</i> <i>(b) Fossil fuels may be co-fired in the project plant. However, the amount of fossil fuels co-fired does not exceed 80% of the total fuel fired on energy basis;</i> <i>(c) For projects that use biomass residues from a production process (e.g. production of sugar or wood panel boards), the implementation of the project does not result in an increase of the processing capacity of (the industrial facility generating the residues) raw input (e.g. sugar, rice, logs, etc.) or in other substantial changes (e.g. product change) in this process;</i> <i>(d) The biomass used by the project plant is not stored for more than one year;</i> <i>(e) The biomass used by the project plant is not processed chemically or biologically (e.g. through esterification, fermentation, hydrolysis, pyrolysis, bio- or chemical degradation, etc.) prior to combustion. Drying and mechanical processing, such as shredding and pelletisation, are allowed.”</i>	Applicable Project activity uses bagasse as renewable biomass which is a biomass residue. There is surplus availability of bagasse in India and hence the implementation of the project does not negatively impact other operations or industries. The bagasse is used without any chemical or biological processes. Biomass used is not stored more than one year. Hence the points (a), (b), (c), (d), (e) are applicable.
<i>“In the case of fuel switch project activities, the use of biomass or the increase in the use of</i>	Not Applicable It is not a fuel switch project activity. Hence the

biomass as compared to the baseline scenario is technically not possible at the project site without a capital investment in: (a) The retrofit or replacement of existing heat generators/boilers; or (b) The installation of new heat generators/boilers; or (c) A new dedicated supply chain of biomass established for the purpose of the project (e.g. collecting and cleaning contaminated new sources of biomass residues that could otherwise not be used for energy purposes); or (d) Equipment for preparation and feeding of biomass.”	criteria is not applicable.
“If biogas is used for power and heat generation, the biogas must be generated by anaerobic digestion of wastewater, and: (a) If the wastewater generation source is registered as a CDM project activity, the details of the wastewater project shall be included in the PDD, and emission reductions from biogas energy generation are claimed using this methodology; (b) If the wastewater source is not a CDM project, the amount of biogas does not exceed 50% of the total fuel fired on energy basis”	Not Applicable Biogas is not produced in the project activity. So the criteria is not applicable.
“In the case biomass from dedicated plantations is used, the “TOOL16: Project and leakage emissions from biomass” shall apply to determine the relevant project and leakage emissions from cultivation of biomass and from the utilization of biomass residues.”	Not Applicable The biomass residue is an industrial waste of sugarcane processing and no dedicated plantation is used to obtain this residue. There are no project and leakage emissions as the plant uses its own waste. Hence the criterion is not applicable.
“The methodology is only applicable if the baseline scenario, as identified per the “Selection of the baseline scenario and demonstration of additionality” section hereunder, is: (a) For power generation: scenarios P2 to P7, or a combination of any of those scenarios; and (b) For heat generation: scenarios H2 to H7, or a combination of any of those scenarios; (c) If some of the heat generated by the CDM project activity is converted to mechanical power through steam turbines, for mechanical power generation: scenarios M2 to M5: (i) In cases M2 and M3, if the steam turbine(s) are used for mechanical power in the project,	Applicable This project activity uses biomass derived as a by-product from their manufacturing process within project boundary and therefore is claiming the emission reduction credits for only the renewable energy powered electricity exported to the grid. Hence, in this document, (b), (c), (d) and (e) are not considered.

<i>the turbine(s) used in the baseline shall be at least as efficient as the steam turbine(s) used for mechanical power in the project;</i> <i>(ii) In cases M4 and M5, steam turbine(s) generating mechanical power to be used for the same purpose as in the baseline are not allowed;</i> <i>(d) For the use of biomass residues: scenarios B1 to B5, or a combination of any of those scenarios;</i> <i>(e) For the use of biogas: scenarios BG1 to BG3, or a combination of any of those scenarios.”</i>	
---	--

B.3. Applicability of double counting emission reductions >>

There is no double accounting of emission reductions in the project activity due to the following reason

- Project has dedicated commissioning certificate and connection point.
- The project is a new green field project and neither registered previously in any other voluntary or compliance program, nor a de-bundled component of any large scale project or Programme of Activities (PoA).
- No previous project was located at the same location.

B.4. Project boundary, sources and greenhouse gases (GHGs)>>

In line with the methodology, the project boundary encompasses the industrial facility of Akbarpur Chini Mills, equipments installed for the operation of cogeneration plant, the biomass storage facility, the facility (sugar unit) consuming the energy (electrical and thermal) generated by the project activity plant and its supply to the grid;

Plant would use the bagasse as renewable fuel for the boiler. Quantity of the biomass required would be generated in-house.

Project boundary of this project is illustrated below:

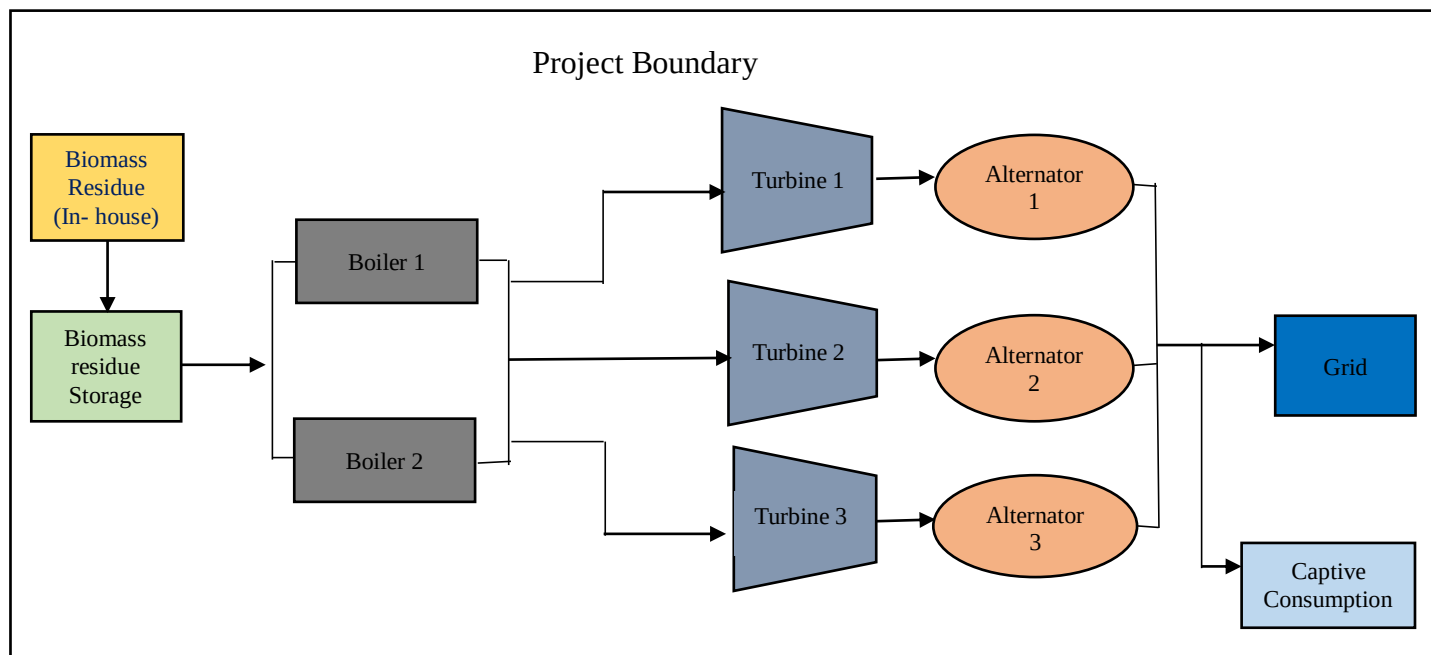


Figure 5: Schematic representation of project boundary

The table below provides an overview of the emission sources included or excluded from the project boundary for determination of baseline and project emission:

Source		Gas	Included	Justification
Baseline	Electricity and heat generation	CO ₂	Yes	Main emission source
		CH ₄	No	Excluded for simplification. This is conservative
		N ₂ O	No	Excluded for simplification.
	Uncontrolled burning or decay of surplus biomass residues	CO ₂	No	Excluded for simplification.
		CH ₄	No	Excluded for simplification.
		N ₂ O	No	Excluded for simplification.
Project Activity	On-site fossil fuel consumption	CO ₂	No	Project activity does not use fossil fuel.
		CH ₄	No	Project activity does not use fossil fuel.
		N ₂ O	No	Project activity does not use fossil fuel.
	Off-site transportation of	CO ₂	No	Biomass is not transported outside the

	biomass			plant premises.
		CH ₄	No	Biomass is not transported outside the plant premises.
		N ₂ O	No	Biomass is not transported outside the plant premises.
	Combustion of biomass for electricity and heat	CO ₂	No	Biomass is a carbon neutral fuel.
		CH ₄	No	Not applicable, as not considered in baseline scenario.
		N ₂ O	No	Excluded for simplification. This emission source is assumed to be small
	Wastewater from the treatment of biomass	CO ₂	No	Biomass does not undergo any treatment. So no wastewater is generated.
		CH ₄	No	Biomass does not undergo any treatment. So no wastewater is generated.
		N ₂ O	No	Biomass does not undergo any treatment. So no wastewater is generated.
	Cultivation of land to produce biomass feedstock	CO ₂	No	Not applicable as biomass is not sourced from dedicated plantations.
		CH ₄	No	Not applicable as biomass is not sourced from dedicated plantations.
		N ₂ O	No	Not applicable as biomass is not sourced from dedicated plantations.

B.5. Establishment and description of baseline scenario (UCR Standard or Methodology) >>

In absence of the project activity equivalent energy would have been generated and supplied to the grid by the power plants connected to the grid which are dominated by fossil fuel fired power generation unit.

Emission Reductions are calculated as follows:

$$ER_y = BE_y - PE_y - LE_y$$

Where,

ER_y = Emissions reductions in year y (t CO₂)

BE_y = Baseline emissions in year y (t CO₂)

PE_y = Project emissions in year y (t CO₂)

LE_y = Leakage emissions in year y (t CO₂)

Baseline emissions are calculated as follows:

$$BE_y = EL_{BL,GR,y} \times EF_{EG,GR,y} + \sum FF_{BL,HG,y,f} \times EF_{FF,y,f} + EL_{BL,FF/GR,y} \times \min(EF_{EG,GR,y}, EF_{EG,FF,y}) + BE_{BR,y}$$

Where,

BE_y = Baseline emissions in year y (t CO₂)

$EL_{BL,,}$ = Baseline electricity sourced from the grid in year y (MWh)

$EF_{EG,}$ = Grid emission factor in year y (t CO₂/MWh)

$FF_{BL,}$ = Baseline fossil fuel demand for process heat in year y (GJ)

$EF_{FF,}$ = CO₂ emission factor for fossil fuel type f in year y (t CO₂/GJ)

$EL_{BL,/GR,y}$ = Baseline uncertain electricity generation in the grid or on-site or off-site power-only units in year y (MWh)

$EF_{EG,}$ = CO₂ emission factor for electricity generation at the project site or off-site plants in the baseline in year y (t CO₂/MWh)

$BE_{BR,}$ = Baseline emissions due to disposal of biomass residues in year y (t CO₂e)

f = Fossil fuel type

Generation of captive thermal and electrical energy from its own by-products like bagasse is a common practice across the sugar mills. The fuel used for the project activity is entirely carbon neutral biomass residue. In absence of the project activity, plant would not have exported green power to grid and consequently other thermal power plants which are dominated by fossil fuels would generate electricity and supply equivalent energy to grid. Hence the emission reduction can only be calculated for the replacement of equivalent grid- mix energy, which would be exported to grid by this project activity, with renewable electricity.

The equation reduces to:

$$BE_y = EL_{BL,GR,y} \times EF_{EG,GR,y}$$

Where,

BE_y = Baseline emissions in year y (t CO₂)

$EL_{BL,GR,y}$ = Baseline electricity sourced from the grid in year y (MWh)

$EF_{EG,}$ = Grid emission factor in year y (t CO₂/MWh)

Plant is exporting surplus energy to grid after captive consumption. Hence as per para 45 of the methodology, $(EL_{BL,y} - CAP_{EG,l,y})$ would be the quantity of electricity supplied to the grid by the project activity which is greater than zero.

Therefore,

$EL_{BL,GR,y}$ = Net electricity exported to grid

Referring to TOOL 16 “Project and leakage emissions from biomass”, the project and leakage emissions for the project activity are zero (0).

Therefore, $PE_y = 0$ and $LE_y = 0$

Estimated Annual or Total baseline emission reductions (BE_y) = 31,126 CoUs /year (31,126 tCO₂eq / year)

B.6. Prior History>>

The project activity has not applied to any other GHG program for registration or issuance of credits for the said crediting period. This is a green field project and has never got registered, de-registered or rejected in any other GHG emission reduction programme before. Also, the project has never been a part of any large scale project activity or a PoA.

B.7. Changes to start date of crediting period >>

There is no change to the start date of crediting period.

B.8. Permanent changes from PCN monitoring plan, applied methodology or applied standardized baseline >>

There are no permanent changes from registered PCN monitoring plan and applied methodology

B.9. Monitoring period number and duration>>

The plant was commissioned in 2004 and the electricity export to the grid therefrom started in 2006. Hence, the start of the crediting period is from 1st January, 2013 as per UCR requirements.

Therefore, First Issuance Period: 10 years, 0 months – 01/01/2013 to 01/01/2023

B.8. Monitoring plan>>

Following parameter would be fixed ex-ante

Data/Parameter	$EF_{EG,GR,y}$
Data unit	t CO ₂ /MWh
Description	Grid emission factor
Source of data	CEA database Version 17.0
Values applied	0.90
Measurement methods and procedures	N/A

Monitoring frequency	Ex- ante fixed parameter
Purpose of data	For estimation of baseline emissions

Following parameter would be monitored ex-post

Data / Parameter:	$EL_{BL,GR,y}$
Data unit:	MWh
Description:	Net electricity exported to grid in year y
Source of data:	Joint meter readings (JMRs)
Measurement procedures (if any):	Data will be measured on- site via calibrated electricity meters
Monitoring frequency:	Monthly
QA/QC procedures:	Calibrations of the main meter will be carried out once in 5 years as per national standards (as per provision of CEA, India). Any faulty meters will be duly replaced immediately as per the provision of PPA. Cross checking Quantity of net electricity supplied to grid will be crossed checked from the invoices raised by the project participants to grid.
Any comment:	All the data will be archived till a period of 2 years from the end of the crediting period.