



# Monitoring Report

## CARBON OFFSET UNIT (CoU) PROJECT



**Title:** 5 MW Small Scale Hydro Power project by M/s Regent Energy Limited

Version 1.0

Date 20/09/2022

First CoU Issuance Period: 04 Years and 02 Months

Monitoring Period: 15/11/2017 to 31/12/2021



**Monitoring Report (MR)  
CARBON OFFSET UNIT (CoU) PROJECT**

Monitoring Report	
Title of the project activity	5 MW Small Scale Hydro Power project by M/s Regent Energy Limited
UCR Project Registration Number	202
Version	1.0
Completion date of the MR	20/09/2022
Monitoring period number and duration of this monitoring period	Monitoring Period Number: 01 Duration of this monitoring Period: 04 Years and 02 Months (first and last days included (15/11/2017 to 31/12/2021)
Project participants	Creduce Technologies Private Limited (Representator) M/s Regent Energy Limited (Project Proponent)
Host Party	India
Applied methodologies and standardized baselines	Applied Baseline Methodology: AMS-I.D.: "Grid connected renewable electricity generation", Version 18
Sectoral scopes	01 Energy industries (Renewable/Non-Renewable Sources)
Estimated amount of GHG emission reductions for this monitoring period in the registered PCN	2017: 1,139 CoUs (1,139 tCO <sub>2</sub> e)
	2018: 25,151 CoUs (25,151 tCO <sub>2</sub> e)
	2019: 27,703 CoUs (27,703 tCO <sub>2</sub> e)
	2020: 28,115 CoUs (28,115 tCO <sub>2</sub> e)
	2021: 28,864 CoUs (28,864 tCO <sub>2</sub> e)
<b>Total:</b>	<b>1,10,972 CoUs (1,10,972 tCO<sub>2</sub>e)</b>

## SECTION A. Description of project activity

### A.1. Purpose and general description of project activity >>

The proposed project activity with title under UCR “5 MW Small Scale Hydro Power project by M/s Regent Energy Limited”, is a grid connected Hydro Electric Power project located in Kinnaur district in the state of Himachal Pradesh (India). The project is an operational activity with continuous reduction of GHG, currently being applied under “Universal Carbon Registry” (UCR). This project is a run-of river project.

#### a) Purpose of the project activity and the measures taken for GHG emission reductions >>

The project activity aims to harness kinetic energy of water (renewable source) to generate electricity. The net generated electricity from the project activity is sold to state electricity board i.e., Himachal Pradesh State Electricity Board Ltd (HPSEBL) under the Power Purchase Agreement (PPA) signed between the Project Proponent (PP) and the utility. In pre-project scenario, electricity delivered to the grid by the project activity would have otherwise been generated by the operation of fossil fuel-based grid-connected power plants and by the addition of new fossil fuel-based generation sources in the grid. Currently, NEWNE grid is connected to large numbers of fossil fuel-based power plants. Hence, project activity is displacing the gross electricity generation i.e., 1,23,305 MWh from the NEWNE grid. The project activity doesn't involve any GHG emission sources. The annual and the total CO<sub>2</sub>e emission reduction by the project activity over the defined monitoring period is as per **Annexure I**.

#### b) Brief description of the installed technology and equipment>>

The project activity involves two pelton wheel hydro turbine generators of horizontal axis of 2500 kW capacity each. The aggregated installed capacity of the power plant is 5 MW (i.e., 5000 kW).

The Project activity comprises of the following different civil structures, combinedly known as hydro power plant. The kinetic energy of water flowing from river is converted into mechanical energy using hydraulic turbine, which is then converted into electrical energy using generator. The water used in this process is again diverted to the river stream through proper arrangements.

Below is the description of different components of a hydro power plant.

1. **Diversion structure (trench weir):** A diversion structure is required across the Nallah for diverting its water for power generation. The Nallah bed consists of pebbles, gravels and boulders.
2. **Intake/Power Channel:** The water fed from Desilting tank is led to tunnel inlet portal through a Rectangular R.C.C channel also known as Intake or Power Channel.
3. **Desilting Tank:** A Desilting chamber is considered necessary to remove silt particles to minimize the abrasion effects on the turbine runners.
4. **Penstock:** Water from Forebay is being taken to the Powerhouse to run hydraulic turbine through pressurized penstock pipe running from Forebay tank.
5. **Power House Building:** Power house building is a simple structure housing the generating units, auxiliary equipment, control panels and suitable outlet for tail water discharge.
6. **Tail Race Channel:** Turbine discharge shall be disposed to river through the separate tailrace channel.

c) Relevant dates for the project activity (e.g., construction, commissioning, continued operation periods, etc.)>>

The duration of the crediting period corresponding to the monitoring period is covered in this monitoring report.

UCR Project ID : 202  
 Start Date of Crediting Period : 15/11/2017  
 The project was commissioned on : 24/02/2011


d) Total GHG emission reductions achieved or net anthropogenic GHG removals by sinks achieved in this monitoring period>>

The total GHG emission reductions achieved in this monitoring period is as follows:

<b>Summary of the Project Activity and ERs Generated for the Monitoring Period</b>	
Start date of this Monitoring Period	15/11/2017
Carbon credits claimed up to	31/12/2021
Total ERs generated (tCO <sub>2</sub> e)	1,10,972 tCO <sub>2</sub> e
Leakage	0
Project Emission	0

e) Baseline Scenario>>

As per the approved consolidated methodology AMS-I.D. Version 18, if the project activity is the installation of a new grid-connected renewable power plant/unit, the baseline scenario is the following: **“The baseline scenario is that the electricity delivered to the grid by the project activity would have otherwise, been generated by the operation of grid-connected power plants and by the addition of new generation sources into the grid”.**

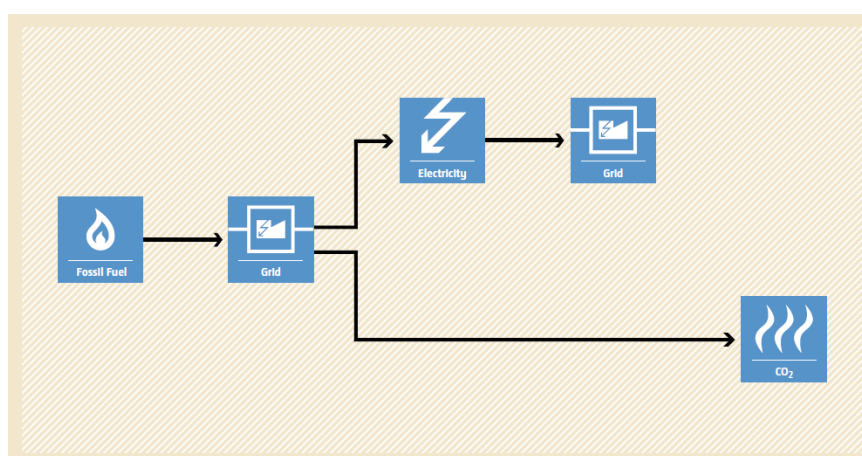


**Figure 1 Baseline Scenario**

## A.2. Location of project activity>>

Country : India  
 State : Himachal Pradesh  
 District : Kinnaur  
 Tehsil : Nichar  
 Village : Rakchad

The power house site of this project is located near Bhava Nagar but on the opposite bank (right bank) of Satluj river. Bhava nagar is about 175 k.m. from Shimla, the State Capital and is accessible through National Highway (NH-22) i.e Chandigarh-Rampur Road. The geographic co-ordinate of the project locations is 31°34'11.0"N and 77°56'36.7"E

The representative location map is included below:

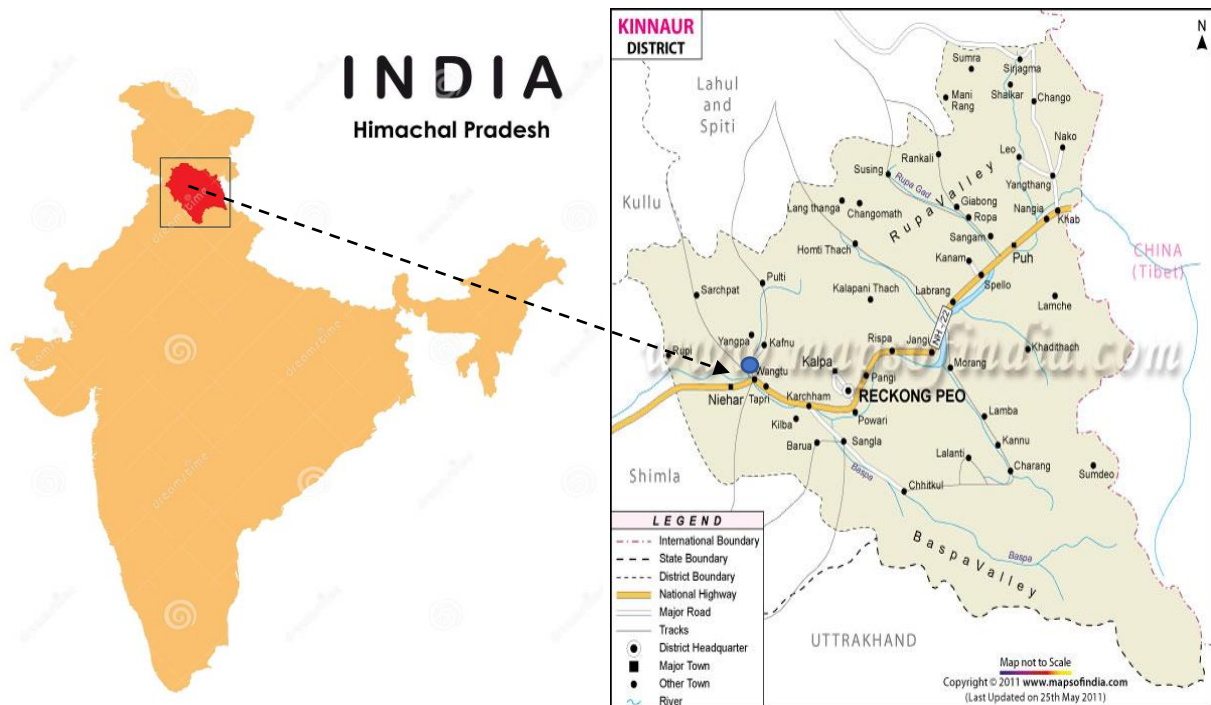

Project Site

### A.3. Parties and project participants >>

Party (Host)	Participants
India	<p><b>Creduce Technologies Private Limited (Representator)</b></p> <p>Contact person: Shailendra Singh Rao Mobile: +91 9016850742, 9601378723 Address: 2-O-13,14 Housing Board Colony, Banswara, Rajasthan - 327001, India.</p> <p><b>M/s Regent Energy Limited (Developer)</b> Address: B-1/H-1, Mohan Cooperative Industrial Estate, Mathura Road, New Delhi-110044, India.</p>

### A.4. References to methodologies and standardized baselines >>

**SECTORAL SCOPE** - 01 Energy industries (Renewable/Non-Renewable Sources)

**TYPE** - Renewable Energy Projects

**CATEGORY** - AMS-I. D: “Grid connected renewable electricity generation”, Version 18

### A.5. Crediting period of project activity >>

Start date : 15/11/2017  
Crediting period corresponding to this monitoring period : 04 Years and 02 Months  
15/11/2017 to 31/12/2021 (Both the dates are inclusive)

### A.6. Contact information of responsible persons/entities >>

Name : Shailendra Singh Rao  
Contact No : +91 9016850742, +91 9601378723  
E-Mail : shailendra@creduce.tech

## SECTION B. Implementation of project activity

### B.1. Description of implemented registered project activity >>

a) Provide information on the implementation status of the project activity during this monitoring period in accordance with UCR PCN>>

The project consists of Two hydro turbines having aggregated installed capacity of 5000 kW which were commissioned on 24/02/2011 at Rakchad village of District Kinnaur, Himachal Pradesh. M/s Regent Energy Limited is the promoter of this project. Rakchad Hydro Electric Project, a run of the river development with installed capacity of 5 MW has been envisaged with the purpose of exploiting the power potential of Salaring Khad, a tributary of river Satluj by harnessing a head of about 270 meter (Net head 260 M) available in the lower reach of Khad to generate 5000 KW of power.

b) For the description of the installed technology, technical process and equipment, include diagrams, where appropriate>>

The project activity involves two hydro turbine generators of Horizontal axis of 2500 kW capacity each. The generators generate power at 6.6 kV, which can further be stepped up to 33 kV. The project activity can operate at rated frequency of 50 Hz and the voltage of 6.6 kV. The average life time of the generator is around 35 years as per the equipment supplier specification. The other salient features of the technology are:

Diversion Weir	
Type	Drop type trench weir
River Bed level	El ± 1658.35 m
Size	2 m wide, 15 m long
Rated Discharge	1.20 cumecs
Single flushing pipe	300 mm dia ± 20 m long
Flushing discharge	0.27 cumecs
Flood Discharge	252 cumecs
Design Discharge	2.39 cumecs at 260 m rated head
Desilting Arrangement	
Type	Surface, Central slit gutter type
Size	40 m x 4 m x 3 m
Water Conductor System	
Type	D shaped open channel
Size	1.8 m x 20 m
Length	1395 m
Slope	1 in 300
Design Discharge	2.63 cumecs
Velocity	2 m/sec
Turbine	
Type	Horizontal axis Pelton
Number	Two
Make	Boving Fouress Pvt. Ltd
Rated Power Output	2750 kW
Speed	600 rpm
Rated Discharge	1200 liters/sec

Generator	
Type	Horizontal axis Synchronous
Make	TD Power Systems Pvt. Ltd.
Generator Rating	2500 kW, 0.85 pf, 2942 kVA, 50 Hz, 10P, 6.6 kV, Y connected stator windings.
Overload Capacity	20%
Runaway Speed	1080 RPM
Penstock	
Type	Circular, Surface Steel Penstock
Size	1000 mm dia.
Thickness	Varying Between 8mm to 18mm
Length	440m
Velocity	4.74m/sec
Centre line at intake	EI±1706 m
Power House	
Type	Surface Power house
Size	25 m x 10 m x 9 m
Capacity	2 x 2500 kW
Rated head	270 m
Tail Race	
Type & Size	RCC Box Section (1m x 1.2m)
Length	25 m

## B.2 Do no harm or Impact test of the project activity>>

Indian economy is highly dependent on “Coal” as fuel to generate energy and for production processes. Thermal power plants are the major consumers of coal in India and yet the basic electricity needs of a large section of population are not being met. This results in excessive demands for electricity and places immense stress on the environment.

Changing coal consumption patterns will require a multi-pronged strategy focusing on demand, reducing wastage of energy and the optimum use of renewable energy (RE) sources. This project is a greenfield activity where grid power is the baseline. The renewable power generation is gradually contributing to the share of clean & green power in the grid; however, grid emission factor is still on higher side which defines grid as distinct baseline.

The Government of India has stipulated following indicators for sustainable development in the interim approval guide lines for such projects which are contributing to GHG mitigations. The Ministry of Environment, Forests & Climate Change, has stipulated economic, social, environment and technological well-being as the four indicators of sustainable development. It has been envisaged that the project shall contribute to sustainable development using the following ways.

**Social well-being:** The project would help in generating direct and indirect employment benefits accruing out of ancillary units for implementation of the Hydro Turbine Generator and for maintenance during operation of the project activity. It will lead to development of infrastructure around the project area in terms of improved road network etc. and will also directly contribute to the development of renewable infrastructure in the region.

**Environmental well-being:** The project utilizes Hydro energy for generating electricity which is a clean source of energy. The project activity will not generate any air pollution, water pollution or solid waste to the environment which otherwise would have been generated through fossil fuels. Also,



it will contribute to reduction GHG emissions. Thus, the project causes no negative impact on the surrounding environment contributing to environmental well-being.


**Economic well-being:** Being a renewable resource, using Hydro energy to generate electricity contributes to conservation precious natural resources. The project contributes to the economic sustainability through promotion of decentralization of economic power, leading to diversification of the national energy supply, which is dominated by conventional fuel based generating units. Locally, improvement in infrastructure will provide new opportunities for industries and economic activities to be setup in the area. Apart from getting better employment opportunities, the local people will get better prices for their land, thereby resulting in overall economic development.

**Technological well-being:** The project activity leads to the promotion of 5 MW Hydro Turbine Generator into the region and will promote practice for small scale industries to reduce the dependence on carbon intensive grid supply to meet the captive requirement of electrical energy and also increasing energy availability and improving quality of power under the service area. Hence, the project leads to technological well-being.


### B.3. Baseline Emissions>>

In the absence of the project activity, the equivalent amount of electricity would have been imported from the regional grid (which is connected to the unified Indian Grid system (NEWNE Grid)), which is carbon intensive due to predominantly sourced from fossil fuel-based power plants.

#### Baseline Scenario:

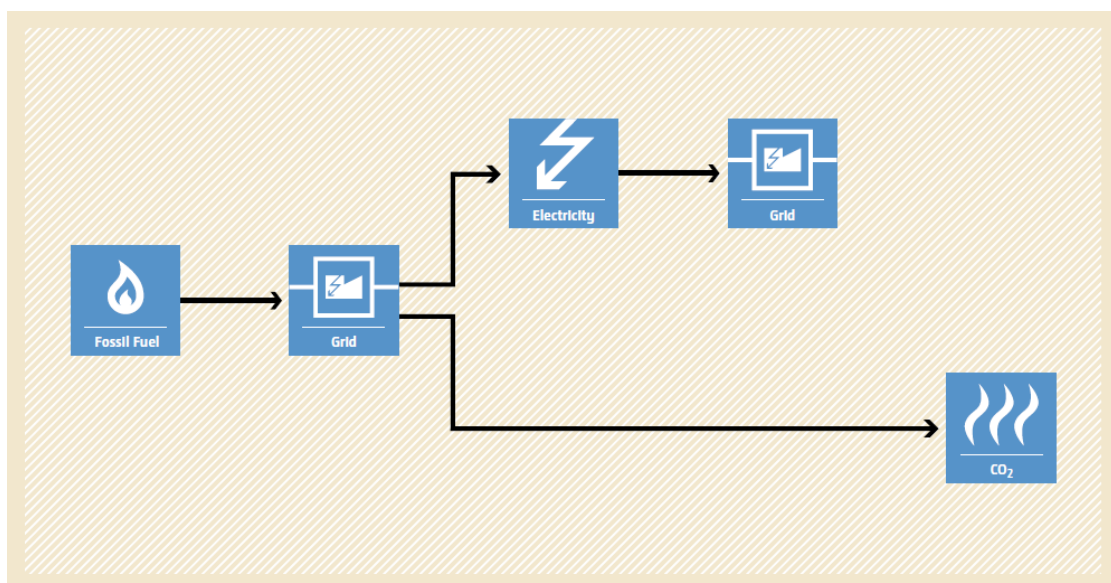

## Project Scenario:

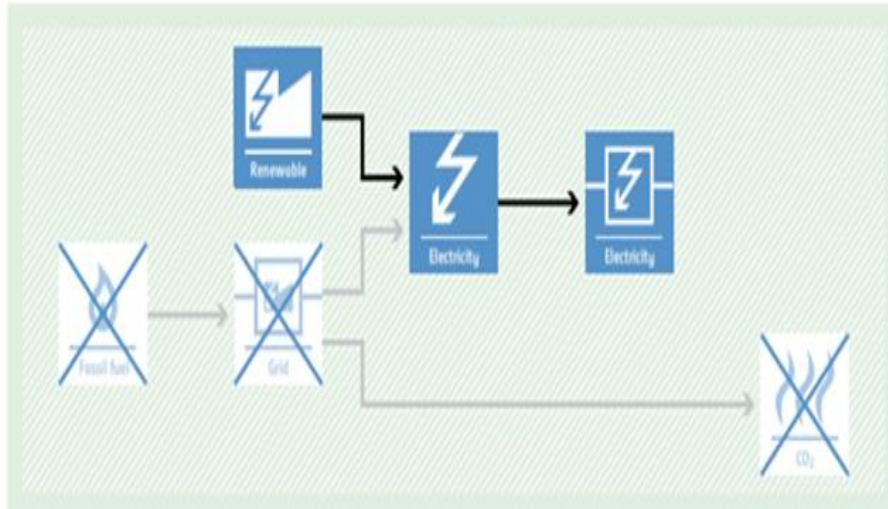

Thus, this project activity was a voluntary investment which replaced equivalent amount of electricity from the Indian grid. The project proponent was not bound to incur this investment as it was not mandatory by national and sectoral policies. Thus, the continued operation of the project activity would continue to replace fossil fuel-based power plants and fight against the impacts of climate change. The Project Proponent hopes that carbon revenues from 2017-2021 accumulated as a result of carbon credits generated will help repay the loans and help in the continued maintenance of this project activity.

### **B.4. Debundling>>**

This project activity is not a de-bundled component of a larger project activity.

## SECTION-C: Application of methodologies and standardized baselines

### C.1. References to methodologies and standardized baselines >>

**Sectoral Scope:** 01 Energy industries (Renewable/Non-Renewable Sources).

**TYPE I** – Renewable Energy Projects.

**Applied Baseline Methodology:** AMS-I.D. “Grid connected renewable electricity generation”, Version 18.

### C.2. Applicability of methodologies and standardized baselines >>

The project activity involves generation of grid connected electricity from the construction and operation of a new Hydro power-based project for selling it to state electricity board i.e., Himachal Pradesh State Electricity Board Ltd (HPSEBL) under the Power Purchase Agreement (PPA) signed between the Project Proponent (PP) and the utility. The project activity has installed capacity of 5 MW which will qualify for a small-scale project activity under Type-I of the Small-Scale methodology. The project status is corresponding to the methodology AMS-I.D., Version 18 and applicability of methodology is discussed below:

Applicability Criterion	Project Case
<p>1. This methodology comprises renewable energy generation units, such as photovoltaic, hydro, tidal/wave, wind, geothermal and renewable biomass:</p> <p>(a) Supplying electricity to a national or a regional grid; or</p> <p>(b) Supplying electricity to an identified consumer facility via national/regional grid through a contractual arrangement such as wheeling.</p>	<p>The project activity is a Renewable Energy Project which falls under applicability criteria option 1 (a) i.e., “Supplying electricity to a national or a regional grid”.</p> <p>Hence the project activity meets the given applicability criterion.</p>
<p>2. This methodology is applicable to project activities that:</p> <p>(a) Install a Greenfield plant;</p> <p>(b) Involve a capacity addition in (an) existing plant(s);</p> <p>(c) Involve a retrofit of (an) existing plant(s);</p> <p>(d) Involve a rehabilitation of (an) existing plant(s)/unit(s); or</p> <p>(e) Involve a replacement of (an) existing plant(s).</p>	<p>The option (a) of applicability criteria 2 is applicable as project is a Greenfield plant /unit. Hence the project activity meets the given applicability criterion.</p>

<p>3. Hydro power plants with reservoirs that satisfy at least one of the following conditions are eligible to apply this methodology:</p> <p>(a) The project activity is implemented in existing reservoir, with no change in the volume of the reservoir; or</p> <p>(b) The project activity is implemented in existing reservoir, where the volume of the reservoir(s) is increased and the power density as per definitions given in the project emissions section, is greater than 4 W/m<sup>2</sup>.</p> <p>(c) The project activity results in new reservoirs and the power density of the power plant, as per definitions given in the project emissions section, is greater than 4 W/m<sup>2</sup>.</p>	<p>It is run of river type of project; hence, this criterion is not applicable.</p>
<p>4. If the new unit has both renewable and non-renewable components (e.g., a wind/diesel unit), the eligibility limit of 15 MW for a small-scale CDM project activity applies only to the renewable component. If the new unit co-fires fossil fuel, the capacity of the entire unit shall not exceed the limit of 15 MW.</p>	<p>The proposed project is 5 MW Hydro Power Project, i.e., only component is renewable power project below 15MW, thus this criterion is not applicable to this project activity.</p>
<p>5. Combined heat and power (co-generation) systems are not eligible under this category.</p>	<p>The project is Hydro Power Project and thus, the criterion is not applicable to this project activity.</p>
<p>6. In the case of project activities that involve the capacity addition of renewable energy generation units at an existing renewable power generation facility, the added capacity of the units added by the project should be lower than 15 MW and should be physically distinct from the existing units.</p>	<p>The proposed project is a greenfield 5 MW Hydro Power Project, i.e., no capacity addition was done to any existing power plant. Thus, this criterion is not applicable to this project activity.</p>
<p>7. In the case of retrofit, rehabilitation or replacement, to qualify as a small-scale project, the total output of the retrofitted, rehabilitated or replacement power plant/unit shall not exceed the limit of 15 MW.</p>	<p>The proposed project is a greenfield 5 MW Hydro Power Project, i.e., no retrofit, rehabilitation or replacement was done to any existing power plant. Thus, this criterion is not applicable to this project activity.</p>
<p>8. In the case of landfill gas, waste gas, wastewater treatment and agro-industries projects, recovered methane emissions are eligible under a relevant Type III category. If the recovered methane is used for electricity generation for supply to a grid, then the baseline for the electricity component shall be in accordance with procedure prescribed under this methodology. If the recovered methane is used for heat generation or cogeneration other applicable Type-I methodologies such as “AMS- I.C.: Thermal energy production with or without</p>	<p>The proposed project is a greenfield 5 MW hydro power project hence, this criterion is not applicable to this project activity.</p>

electricity” shall be explored.	
9. In case biomass is sourced from dedicated plantations, the applicability criteria in the tool “Project emissions from cultivation of biomass” shall apply.	No biomass is involved, the project is only a Hydro Power Project and thus the criterion is not applicable to this project activity.

### C.3 Applicability of double counting emission reductions >>

The project was not applied under any other GHG mechanism. Hence project will not cause double accounting of carbon credits (i.e., COUs).

### C.4. Project boundary, sources and greenhouse gases (GHGs)>>

As per applicable methodology AMS-I.D. Version 18, **“The spatial extent of the project boundary includes the project power plant and all power plants connected physically to the electricity system.”**

Thus, the project boundary includes the Hydro Turbine Generator and the Indian grid system.

Source		Gas	Included?	Justification/Explanation
Baseline	Grid connected electricity generation	CO <sub>2</sub>	Yes	<b>CO<sub>2</sub> emissions from electricity generation in fossil fuel fired power plants</b>
		CH <sub>4</sub>	No	Minor emission source
		N <sub>2</sub> O	No	Minor emission source
		Other	No	No other GHG emissions were emitted from the project
Project	Greenfield Hydro Power Project Activity	CO <sub>2</sub>	No	No CO <sub>2</sub> emissions are emitted from the project
		CH <sub>4</sub>	No	Project activity does not emit CH <sub>4</sub>
		N <sub>2</sub> O	No	Project activity does not emit N <sub>2</sub> O
		Other	No	No other emissions are emitted from the project

### C.5. Establishment and description of baseline scenario (UCR Protocol) >>

As per para 19 of the approved consolidated methodology AMS-I.D. Version 18, if the project activity is the installation of a new grid-connected renewable power plant/unit, the baseline scenario is the following:

**“The baseline scenario is that the electricity delivered to the grid by the project activity would have otherwise been generated by the operation of grid-connected power plants and by the addition of new generation sources into the grid”.**

The project activity involves setting up of a new hydro power plant to harness the green power from hydro energy and to use for sale to national grid i.e., India grid system through PPA arrangement. In the absence of the project activity, the equivalent amount of power would have been generated by the operation of grid-connected fossil fuel-based power plants and by the addition of new fossil fuel-

based generation sources into the grid. The power produced at grid from the other conventional sources which are predominantly fossil fuel based. Hence, the baseline for the project activity is the equivalent amount of power produced at the Indian grid.

A "grid emission factor" refers to a CO<sub>2</sub> emission factor (tCO<sub>2</sub>/MWh) which will be associated with unit of electricity provided by an electricity system. The UCR recommends an emission factor of 0.9 tCO<sub>2</sub>/MWh for the 2014-2020 years as a fairly conservative estimate for Indian projects not previously verified under any GHG program. Also, for the vintage 2021, the combined margin emission factor calculated from CEA database in India results into same emission factors as that of the default value. Hence, the same emission factor has been considered to calculate the emission reduction.

### Net GHG Emission Reductions and Removals

$$ER_y = BE_y - PE_y - LE_y$$

Where:

- ER<sub>y</sub> = Emission reductions in year y (tCO<sub>2</sub>/y)
- BE<sub>y</sub> = Baseline emissions in year y (t CO<sub>2</sub>/y)
- PE<sub>y</sub> = Project emissions in year y (tCO<sub>2</sub>/y)
- LE<sub>y</sub> = Leakage emissions in year y (tCO<sub>2</sub>/y)

### Baseline Emissions

Baseline emissions include only CO<sub>2</sub> emissions from electricity generation in power plants that are displaced due to the project activity. The methodology assumes that all project electricity generation above baseline levels would have been generated by existing grid-connected power plants and the addition of new grid-connected power plants.

The baseline emissions are to be calculated as follows:

$$BE_y = EG_{PJ,y} \times EF_{grid,y}$$

Where:

- BE<sub>y</sub> = Baseline emissions in year y (tCO<sub>2</sub>)
- EG<sub>PJ,y</sub> = Quantity of net electricity generation that is produced and fed into the grid as a result of the implementation of this project activity in year y (MWh)
- EF<sub>grid,y</sub> = UCR recommended emission factor of 0.9 tCO<sub>2</sub>/MWh has been considered, this is conservative as compared to the combined margin grid emission factor which can be derived from Database of Central Electricity Authority (CEA), India. (Reference: General Project Eligibility Criteria and Guidance, UCR Standard, page 4)

Hence,

Baseline Emissions Calculation				
Sr.No	Year	EG <sub>py</sub> (MWh)	EF <sub>grid,y</sub>	BE <sub>y</sub>
1	2017	1265.64	0.9	1139
2	2018	27946.50	0.9	25151
3	2019	30782.00	0.9	27703
4	2020	31239.50	0.9	28115
5	2021	32071.30	0.9	28864
6	BE (tCO <sub>2e</sub> ) for the period of 2017 to 2021			110972

### Project Emissions

As per paragraph 39 of AMS-I.D., for most renewable energy project activities emission is zero. Since the project activity is run of river type Hydro Power Plant Installation, project emission for this plant is nil.

Hence,

$$PE_y = 0$$

### Leakage Emissions

As per paragraph 42 of AMS-I.D. Version-18, all projects other than Biomass projects have zero leakage.

Hence,

$$LE = 0$$

Total Emission reduction by the project for the current monitoring period is calculated as below:

Hence,

$$ER = 1,10,972 - 0 - 0 = 1,10,972 \text{ CoUs}$$

### C.6. Prior History>>

The project had applied for registration in 2010 to CDM registry with Project ID 3022: Rakchad Small Hydro Electric Project. The Project has been registered for the period of 1/03/2010 to 28/02/2017. Last monitoring report have been generated for period of 1/01/2014 to 14/11/2017. Request for issuance has been made. All the details for this project on CDM are provided in the link bellow:

<https://cdm.unfccc.int/Projects/DB/DNV-CUK1254893204.97/view>

Since the start date of crediting period in the Universal Carbon Registry is 15/11/2017, Thus it will not cause Double Counting.

### C.7. Monitoring period number and duration>>

First Monitoring Period : 04 Years and 02 Months  
15/11/2017 to 31/12/2021 (inclusive of both dates)

### C.8. Changes to start date of crediting period >>

The start date of crediting under UCR is 15/11/2017, which is Considered for registering and monitoring under UCR and no GHG emission reduction has been claimed after that in in any other registry.

### C.9. Permanent changes from PCN monitoring plan, applied methodology or applied standardized baseline >>

There are no permanent changes from registered PCN monitoring plan and applied methodology.

### C.10. Monitoring plan>>

The project activity essentially involves generation of electricity, the employed Hydro Power Plant can only convert Hydro energy into electrical energy and does not use any other fossil fuel for electricity generation, thus no special ways and means are required to monitor leakage from the project activity. The recording of the electricity fed to the state utility grid is carried out jointly at the incoming feeder of the state power utility (HPSEBL).

Parameter	EG <sub>PJ</sub>
Data unit	MWh
Description	Total quantity of net electricity generation that is produced and fed into the grid as a result of the implementation of this project activity during crediting period.
Source of data Value(s) applied	JMR
Values Applied	1,23,305
Procedures	The Net electricity generation by the hydro power plant is recorded at the sub-station. At the end of every month Joint Meter Reading (JMR) is generated based on the total monthly electricity exported to the grid.
Monitoring frequency	Monthly
Purpose of data	To Calculate Baseline Emission

Data / Parameter	UCR recommended emission factor
Data unit	tCO <sub>2</sub> /MWh
Description	A "grid emission factor" refers to a CO <sub>2</sub> emission factor (tCO <sub>2</sub> /MWh) which will be associated with unit of electricity provided by an electricity system. The UCR recommends an emission factor of 0.9 tCO <sub>2</sub> /MWh for the 2014 - 2020 years as a fairly conservative estimate for Indian projects not previously verified under any GHG program. Hence, the same emission factor has been considered to calculate the emission reduction under conservative approach.



Source of data	<a href="https://a23e347601d72166dcd6-16da518ed3035d35cf0439f1cdf449c9.ssl.cf2.rackcdn.com//Documents/UCRStandardAug2022updatedVer5_030822005728911983.pdf">https://a23e347601d72166dcd6-16da518ed3035d35cf0439f1cdf449c9.ssl.cf2.rackcdn.com//Documents/UCRStandardAug2022updatedVer5_030822005728911983.pdf</a>
Value applied	0.9
Measurement methods and procedures	-
Monitoring frequency	Ex-ante fixed parameter
Purpose of Data	For the calculation of Emission Factor of the grid
Additional Comment	The combined margin emission factor as per CEA database (current Version 16, Year 2021) results into higher emission factor. Hence for 2021 vintage UCR default emission factor remains conservative.

## ANNEXURE I (Emission Reduction Calculation)

<b>5 MW Small Scale Hydro power project by M/s Regent Energy Limited</b>												
<b>Month - Wise Energy Delivered to Grid (in kWh)</b>												
Year	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
2017	-	-	-	-	-	-	-	-	-	-	84,341	11,81,300
2018	8,91,100	6,38,100	11,40,000	20,02,500	28,99,900	27,58,400	37,00,700	33,73,600	37,83,100	31,18,200	21,24,300	15,16,600
2019	10,27,800	11,34,700	16,58,400	38,29,300	39,16,900	37,29,100	38,36,600	35,61,400	34,08,500	23,71,200	13,60,400	9,47,700
2020	11,12,500	14,04,500	21,34,300	34,56,000	40,02,100	38,51,000	36,14,000	31,80,300	35,36,300	22,58,200	14,70,300	12,20,000
2021	10,09,300	7,95,100	14,64,400	27,78,200	40,79,500	40,32,600	36,09,200	38,97,300	33,66,600	36,82,100	20,01,500	13,55,500
<b>Year-Wise Emission reduction calculation for the project activity</b>												
Year	Total No. of Electricity delivered in kWh			Recommended emission factor tCO <sub>2</sub> /MWh			Total CoUs generated					
2017	12,65,641			0.9			1,139					
2018	2,79,46,500			0.9			25,151					
2019	3,07,82,000			0.9			27,703					
2020	3,12,39,500			0.9			28,115					
2021	3,20,71,300			0.9			28,864					
<b>Total CoUs to be issued for the first monitoring period (Year: 2017 to 2021)</b>											<b>1,10,972</b>	